


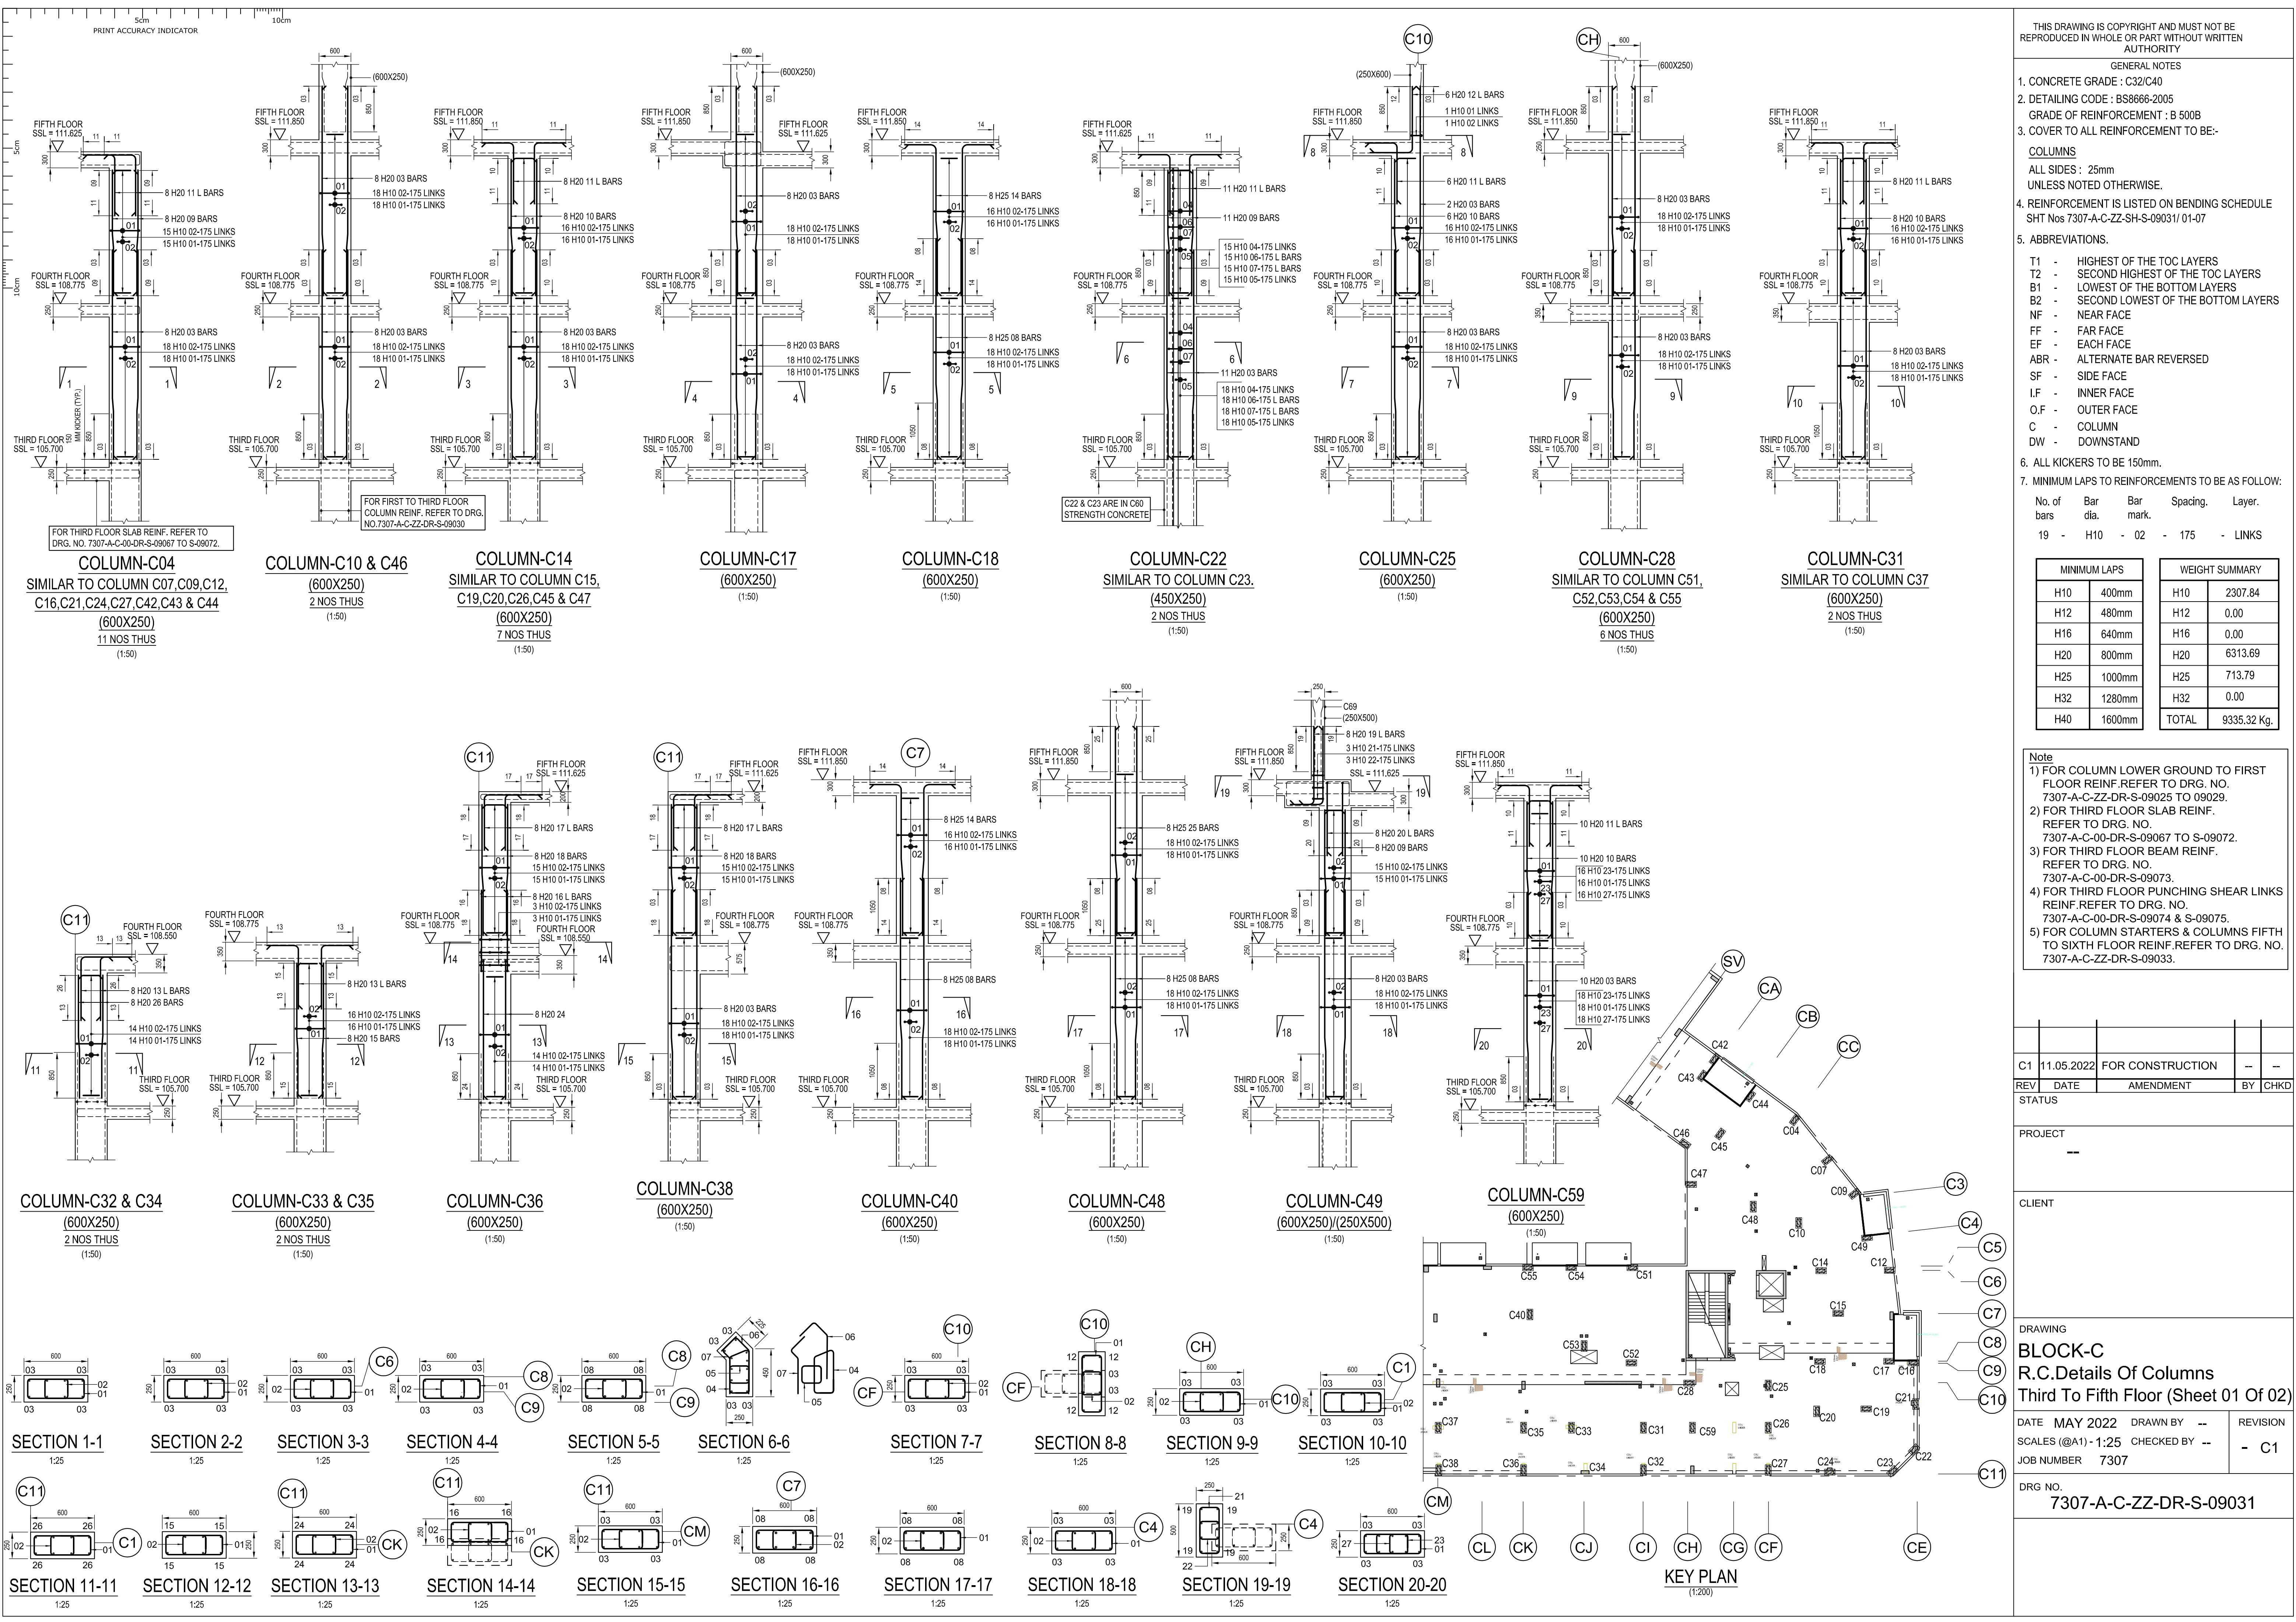

THIS DRAWING IS COPYRIGHT AND MUST NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN AUTHORITY

- GENERAL NOTES
- CONCRETE GRADE : C32/C40
 - DETAILING CODE : BS8666-2005
 - GRADE OF REINFORCEMENT : B 500B
 - COVER TO ALL REINFORCEMENT TO BE:-
- COLUMNS
- ALL SIDES : 25mm
- UNLESS NOTED OTHERWISE.
4. REINFORCEMENT IS LISTED ON BENDING SCHEDULE
- SHT Nos 7307-A-C-ZZ-SH-S-09031/ 01-07
5. ABBREVIATIONS.

- T1 - HIGHEST OF THE TOC LAYERS
- T2 - SECOND HIGHEST OF THE TOC LAYERS
- B1 - LOWEST OF THE BOTTOM LAYERS
- B2 - SECOND LOWEST OF THE BOTTOM LAYERS
- NF - NEAR FACE
- FF - FAR FACE
- EF - EACH FACE
- ABR - ALTERNATE BAR REVERSED
- SF - SIDE FACE
- I.F - INNER FACE
- O.F - OUTER FACE
- C - COLUMN
- DW - DOWNSTAND

6. ALL KICKERS TO BE 150mm.
7. MINIMUM LAPS TO REINFORCEMENTS TO BE AS FOLLOW:
- | No. of bars | Bar dia. | Bar mark. | Spacing. | Layer. |
|-------------|----------|-----------|----------|--------|
| 19 | H10 | 02 | 175 | LINKS |

MINIMUM LAPS		WEIGHT SUMMARY	
H10	400mm	H10	2307.84
H12	480mm	H12	0.00
H16	640mm	H16	0.00
H20	800mm	H20	6313.69
H25	1000mm	H25	713.79
H32	1280mm	H32	0.00
H40	1600mm	TOTAL	9335.32 Kg.

- Note
- FOR COLUMN LOWER GROUND TO FIRST FLOOR REINF.REFER TO DRG. NO. 7307-A-C-ZZ-DR-S-09025 TO 09029.
 - FOR THIRD FLOOR SLAB REINF. REFER TO DRG. NO. 7307-A-C-00-DR-S-09067 TO S-09072.
 - FOR THIRD FLOOR BEAM REINF. REFER TO DRG. NO. 7307-A-C-00-DR-S-09073.
 - FOR THIRD FLOOR PUNCHING SHEAR LINKS REINF.REFER TO DRG. NO. 7307-A-C-00-DR-S-09074 & S-09075.
 - FOR COLUMN STARTERS & COLUMNS FIFTH TO SIXTH FLOOR REINF.REFER TO DRG. NO. 7307-A-C-ZZ-DR-S-09033.

C1	11.05.2022	FOR CONSTRUCTION	--	--
REV	DATE	AMENDMENT	BY	CHKD
STATUS				

PROJECT

--

CLIENT

DRAWING

BLOCK-C

R.C.Details Of Columns

Third To Fifth Floor (Sheet 01 Of 02)

DATE MAY 2022 DRAWN BY -- REVISION

SCALES (@A1)- 1:25 CHECKED BY -- - C1

JOB NUMBER 7307

DRG NO.

7307-A-C-ZZ-DR-S-09031